


PLAN VIEW

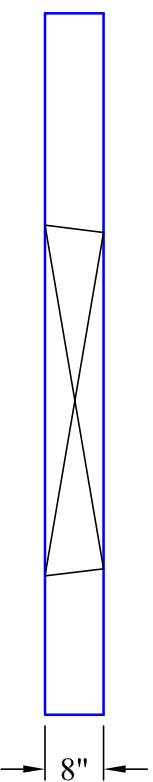

SECTION A-A

- NOTES:
1. 4,000 PSI CONCRETE AT 28 DAYS.
 2. REINFORCEMENT BARS PER ASTM A-615, GRADE 60 WELDED WIRE FABRIC PER ASTM A-185, GRADE 70
 3. ANY ALTERATION TO THIS DRAWING MUST BE SUBMITTED TO GSP IN WRITING PRIOR TO PRODUCTION.

SHEET
1
OF
1

WEIGHT
8" PAD=5,820 LBS.
LIFTING
(4) 5" UTILITY ANCHORS

PRECAST TYPE III-A
TRANSFORMER PAD
96" x 96" x 8"
W085020 DG-12-785-3

GARDEN STATE PRECAST
FARMINGDALE, N.J.
PHONE #: 732-938-4436 FAX #: 732-938-6069