


PLAN VIEW


SPECIFY SERVICE CONDUIT SIZE

(4) 1"Ø ANCHOR BOLTS WITH 1" OF THREAD. COUPLINGS, STN. STL. HEX HEAD CAP SCREWS, STN. STL. LOCK WASHERS AND STL. STL. FLAT WASHERS. ALL THREADS SHALL BE 8NC CLASS 2 FTI.

SEE GENERAL PLAN SHEETS FOR NUMBER & SIZE OF CONDUITS REQUIRED AND POSITION OR DIRECTION CONDUIT SHALL RUN.

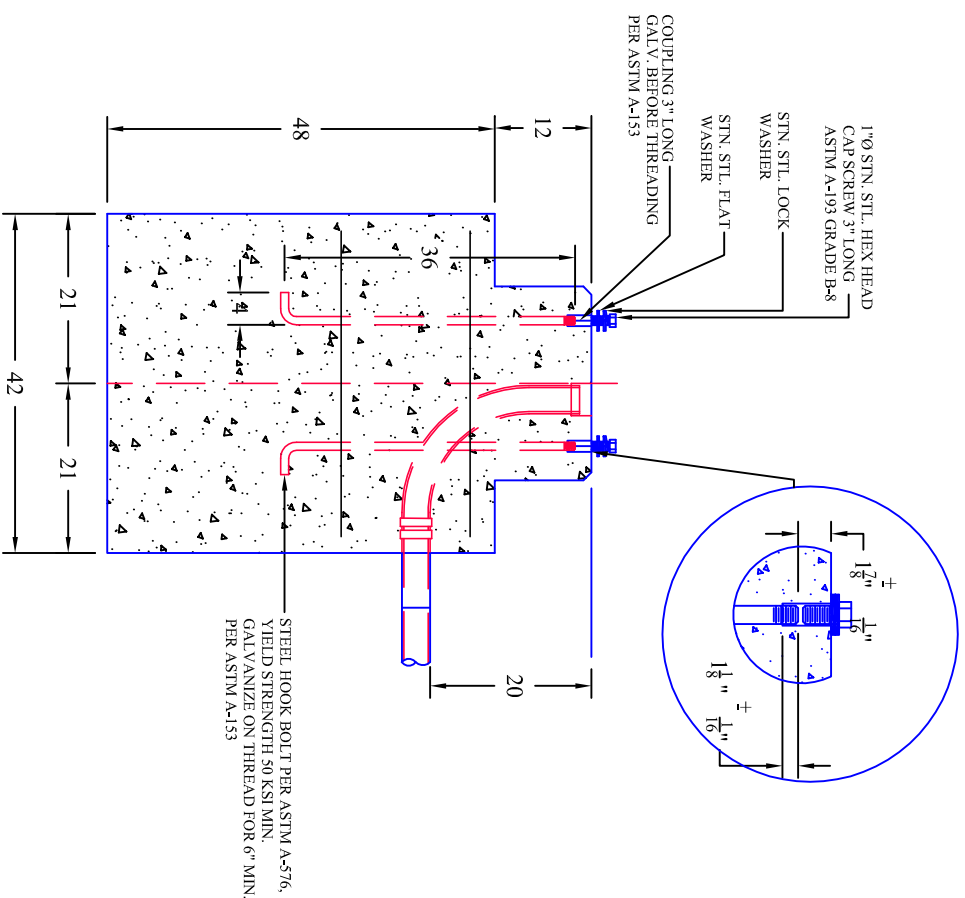


SECTION A-A'

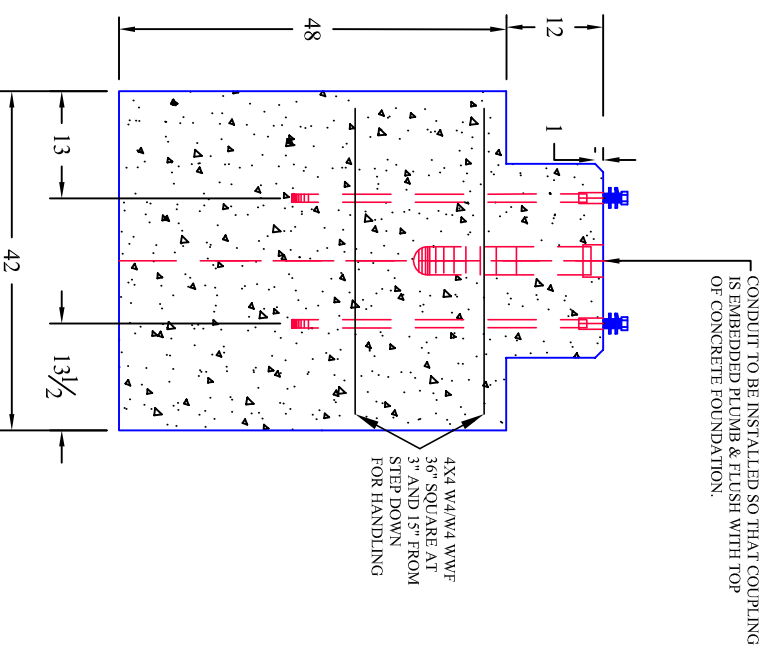

SECTION B-B'

ITEM		
1	3/4" GROUND ROD SLEEVE	
2	3" RMC	
3	RMC SERVICE PER PLAN	1
4	2" RMC	
5	1" RMC DRAIN	
6	3/4" X 12 JBOLT WITH COUPLER	
7	1" X 36" JBOLT WITH COUPLER	4
8	1 3/4" X 90" ANCHOR BOLTS	
9	BLANK	

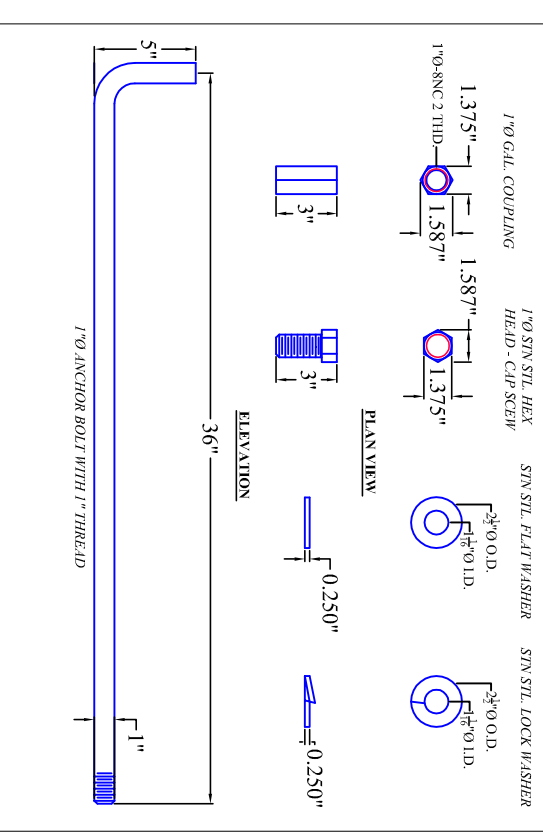

- NOTES:
1. CLASS B CONCRETE.
 2. REINFORCEMENT BARS PER ASTM A-615 GRADE 60.
 3. WELDED WIRE REINFORCEMENT PER ASTM A-185 GRADE 70.
 4. WEIGHT = 8,000 LB
 5. (1) 5" UTILITY ANCHOR IN MIDDLE OF EACH WALL. 22" FROM TOP. (TOTAL OF 4)
 6. BOLTS, WASHERS AND GROUND ROD SUPPLIED BY CONTRACTOR

FOUNDATION TYPE "SFK"



GARDEN STATE PRECAST
 1630 WYCKOFF ROAD
 WALL, NJ 07719

P. 732-938-4436

F. 732-938-6069